

6 Layers: 3 Layers of Plasterboard to each side of frame

System Number	Lining Suffix	Fire Rating	Load Bearing Ability	Noise Control		Lining Requirement
				STC	Rw	
E6TL120	-F78	120/120/120	LB	44	43	3 x 13mm EPB FireSmart® on One side 3 x 13mm EPB FireSmart® to Other side

Framing

Framing to comply with relevant sections and clauses of NZBC B1: Structure and NZBC B2: Durability.
Studs at 600mm centres maximum.
Nogs at 800mm centre maximum.

Wall Height, Load and Framing Dimensions

These are determined by NZS3604 stud tables for load bearing or non-load bearing partitions.

Plasterboard Lining

NB: The installer must look for the Product Identification Code on the face paper to ensure the correct board type is installed. Refer to the Face Paper Product Identification Code table on this page.

Three layers of 13mm EPB FireSmart® lining on each side of the timber framing.

Vertical fixing only permitted. Use full height sheets where possible.

Vertical Fixing- the vertical sheet joints must be offset on the opposite side of the frame and staggered between layers.

Sheet end butt joints- must be formed over framing, offset from opposite side of the frame and staggered between layers.

All sheet joints must be fixed over solid timber framing.
Sheets shall be touch fitted.

Fixing of Linings

Fasteners

System Number	1 st Layer	2 nd Layer	3 rd Layer
		High Thread Drywall Screws	
E6TL120-F78	13mm	13mm	13mm
	41 x 6g	51 x 7g	63 x 8g

Fastener Centres

1st and 2nd Layer: Fix 600mm centres at sheet perimeters and on top and bottom plates. Fix at 600mm up each stud

3rd Layer: Fix at 300mm centres at sheet perimeters and on top and bottom plates and 300mm centres up each stud.

Place fasteners 50mm from sheet corners along the top and bottom plates. On end studs place additional fasteners 50-60mm vertically and no close than 10mm from plate to stud connections.


Place fasteners no closer than 12mm from the sheet edges and 18mm from sheet ends.

Place fasteners at 200mm centres where sheet end butt joints occur.
Avoid outer layer screws from hitting inner layer screws.

Jointing

1st and 2nd Layer: Unstopped

3rd Layer: All fastener heads stopped and all sheet joints reinforced with paper jointing tape and stopped. All in accordance with EPB® Plasterboard Installation Guide.

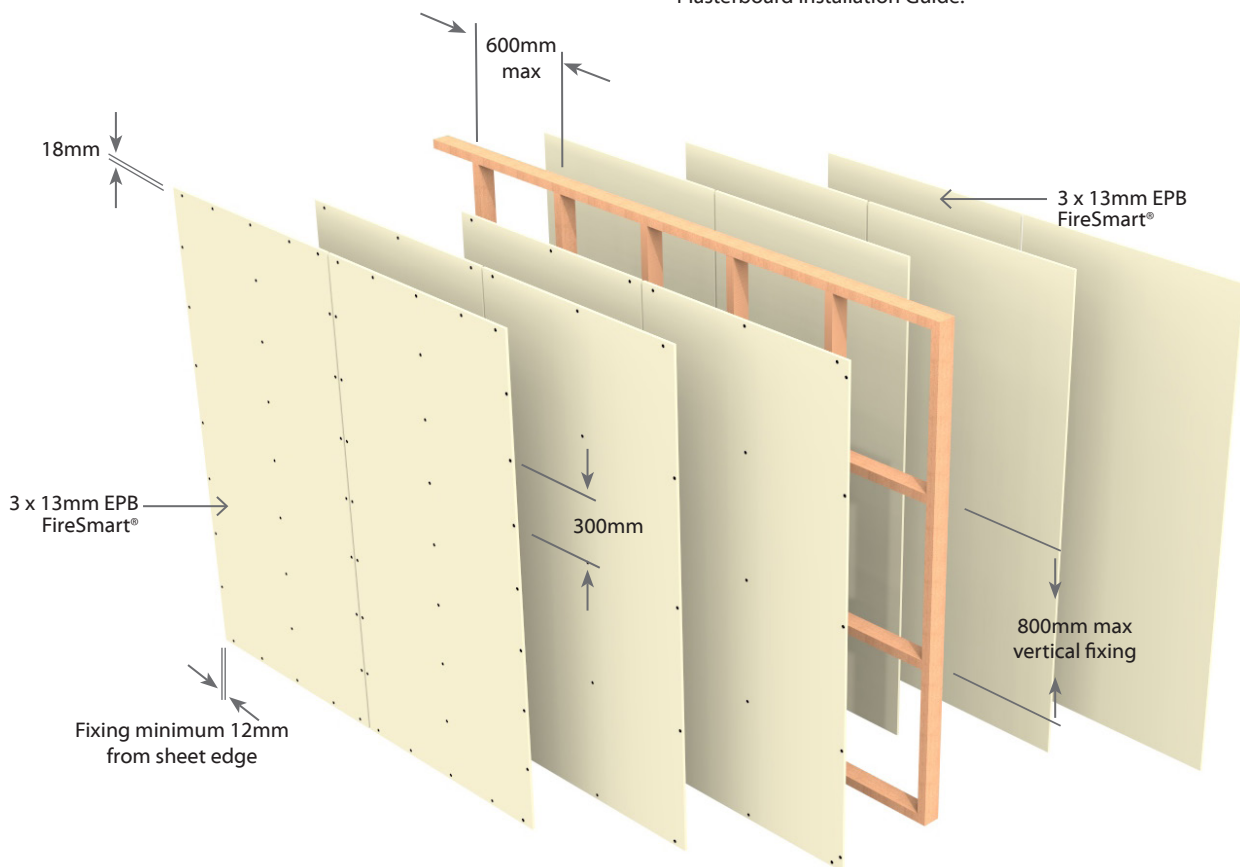

Face Paper Product Identification Code	
13mm EPB FireSmart®	F13

